

Nirbo water features are made from high quality stainless steel material, are very durable and have excellent fun factor.

There are over one hundred different water features to choose from, this product is just a great example. We use brass or stainless steel nozzles which are ideal materials for the application.

Three Candies | 03414


GPM PSI		LPM	Bar	
10 10		40	0.7	
Width	Length	Height		
68" (173 cm)	75" (191 cm) 82" (208	3 cm)	







В

Α

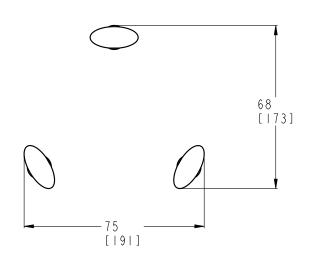

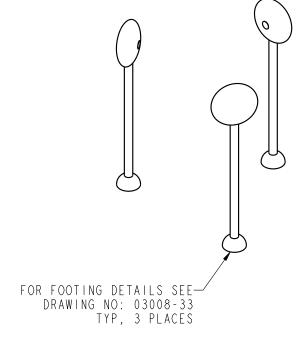

1

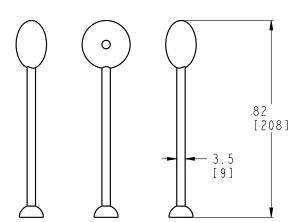


SPRAY ZONE Ø96 [244]

FLOW (5-10 PSI)	LOW	NORMAL	HIGH	
GPM-[LPM]	21[84]	30[120]	45[180]	

- I STRUCTURE: TYPE 304 STAINLESS STEEL NOZZLE: BRASS OR STAINLESS WITH TAMPER RESISTANT FEATURES
- 2- FINISH: UV RESISTANT POLYESTER POWDER COATING
- 3- PRODUCT INCLUDES:
 ANCHOR BOLTS WITH HARDWARE AND FOOTING TEMPLATE
 SPRAY NOZZLES
 WINTER NOZZLE CAPS
 SERVICE TOOLS
 TAMPER RESISTANT HARDWARE
- 4- GROUND COMPONENT WITH #6 BARE COPPER WIRE
- 5- PRODUCT COMPLIANCE:
 MEETS ADA ACCESSIBILITY GUIDELINES
 MEETS CURRENT ASTM F1487 SAFETY STANDARDS

NIRBO
AQUATIC INC.



ALL INFORMATION CONTAINED IN THIS DOCUMENT IS PROPERTY OF NIRBO AQUATIC INC. AND MAY NOT BE REPRODUCED OR COMMUNICATED WITHOUT PERMISSION IN WRITING FROM NIRBO AQUATIC INC.


(yyyy.mm.dd)	THREE CANDIES,				
2013.10.21					
UNIT	SHEET	DRAWING NO	REV		
INCH			^ 1		
L CM J	11/2	03414-02-D15	0		

2

SCALE 1:40

Α

В

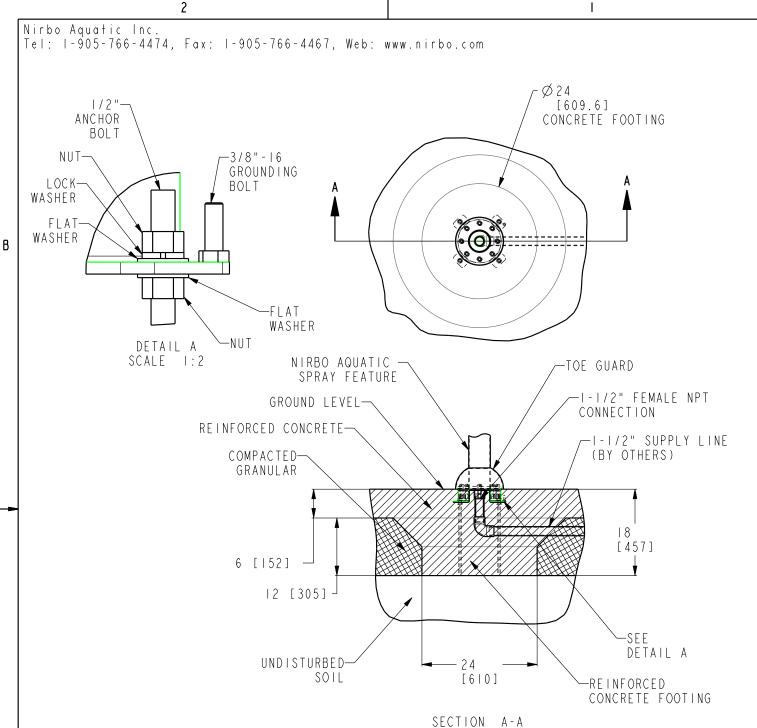

NOTES:

A

- I- FOLLOW LOCAL CODES, WHEREVER APPLICABLE.
- 2- GRANULAR BASE THICKNESS SHALL MEET LOCAL BUILDING CODE REQUIREMENTS.
- 3- WATER SUPPLY LINE SHALL BE INSTALLED PER LOCAL BUILDING CODES.
- 4- HARDWARE SUPPLIED BY MANUFACTURER SHALL BE USED.

AQUATIC INC. ALL INFORMATION CONTAINED IN THIS DOCUMENT IS PROPERTY OF NIRBO AQUATIC INC. AND MAY NOT BE REPRODUCED OR	DATE (yyyy.mm.dd) 2018.10.24	SURFACE MOUNTED INSTALLATION, 3" & 4" PIPES		
COMMUNICATED WITHOUT PERMISSION IN WRITING FROM NIRBO AQUATIC INC.	UNIT INCH [mm]	SHEET /	DRAWING NO 03008-33	REV 0

2

В